



## Wiring RAD Relay with External Relay

**Note:** This diagram shows the connections required to control a 120VAC exhaust fan from a RAD-0102-6 Remote CO2 Storage Safety Dual Relay Alarm.



**LY2**

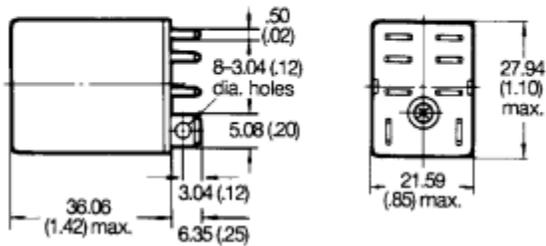


**Terminal arrangement (Bottom view)**



**\*\*\*The Relay plugs into the terminal block to provide screw terminal connection\*\*\***

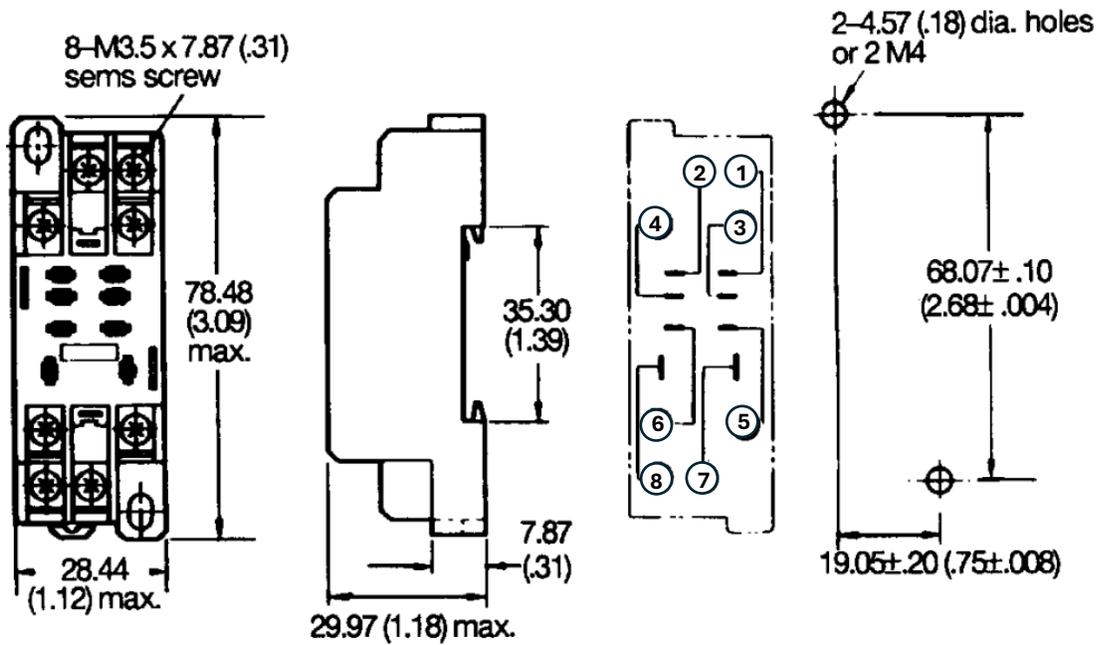

## Wiring RAD Relay with External Relay

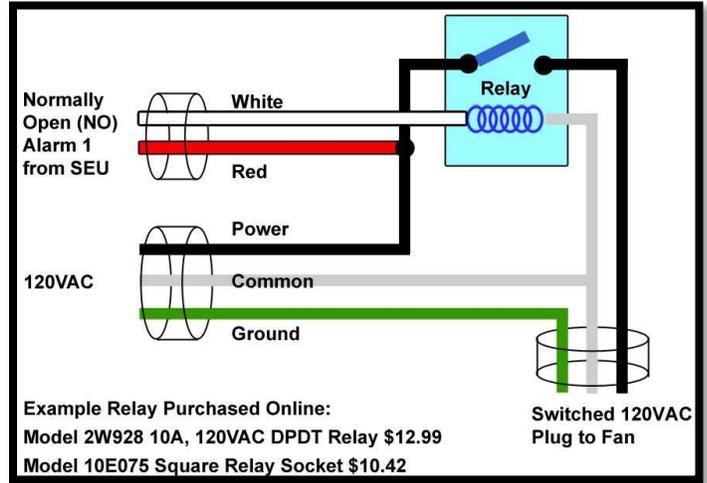

- RAD-0102-6
- Relay 1\_NC
- Relay 1\_COM
- Relay 1\_NO
- Relay 2\_NC
- Relay 2\_COM
- Relay 2\_NO
- Relay 3\_NC
- Relay 3\_COM
- Relay 3\_NO
- Power + 12VDC
- Power (GND)

